


CURVE SHOWS APPROXIMATE PERFORMANCE FOR CLEAR WATER (International Test Standard ISO9906:1999 - Grade 2 unless otherwise specified). For media other than water, corrections must be made for density, viscosity and/or other effects of solids. WEIR MINERALS reserves the right to change pump performance and/or delete impellers without notice. Frame suitability must be checked for each duty and drive arrangement. Not all frame alternatives are necessarily available from each manufacturing centre.

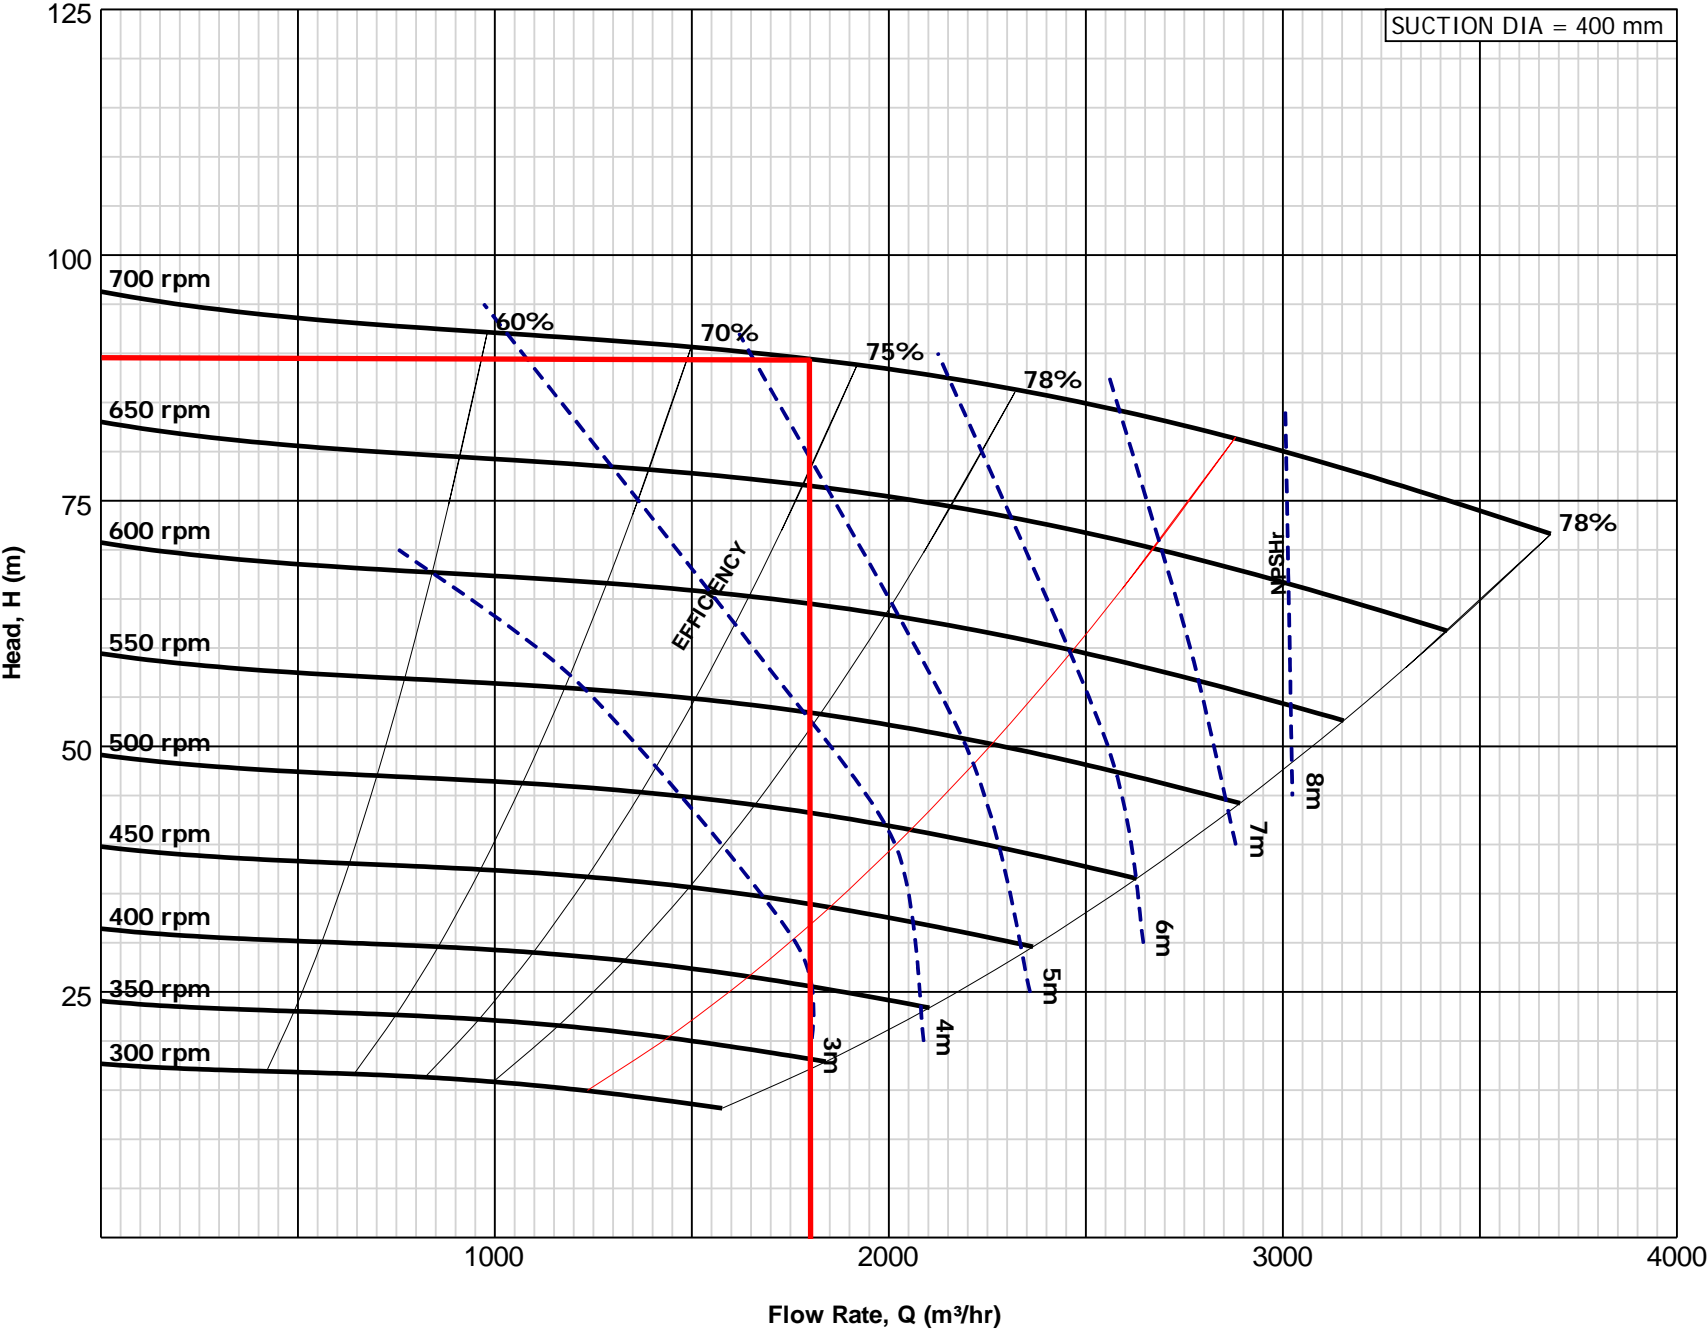

Pump	
Discharge	300mm
Suction	350mm
Impeller	
Vanes	3
Vane ø	1020mm
Type	Closed
Part No	Material
THG30137LPT1	Metal
Frame (Rating - KW)	
TU	1200
Seal	
Gland Sealed Pump	
Liner (Norm Max r/min)	
Unlined	700
Min Passage Size	
240mm	
Curve	
Revision	1
Revision Notes	NEW TESTED PERFORMANCE CURVE & NOTE ADDED
Reference	TOD
Issued	Jun 07
© 12/2015 Weir Minerals Australia (PTC) All Rights Reserved	
TYPICAL PUMP PERFORMANCE CURVE	
WPA300F12/1	